

CONDUCTOR SCHEDULE

3701	4326 MCM ALUM. WIRE
3703	6 INCH IPS ALUM TUBING SCH.80
3705	6 INCH IPS ALUM TUBING SCH.40


GENERAL NOTES:

1. FOR CONSTRUCTION NOTES SEE AEP TECHNICAL SPECIFICATION FOR SUBSTATION AND SWITCHING STATION CONSTRUCTION #SS-180102


NUMBERS IN  REFER TO REPORT BM#

REFERENCE DRAWINGS

ONE LINE DIAGRAM E-

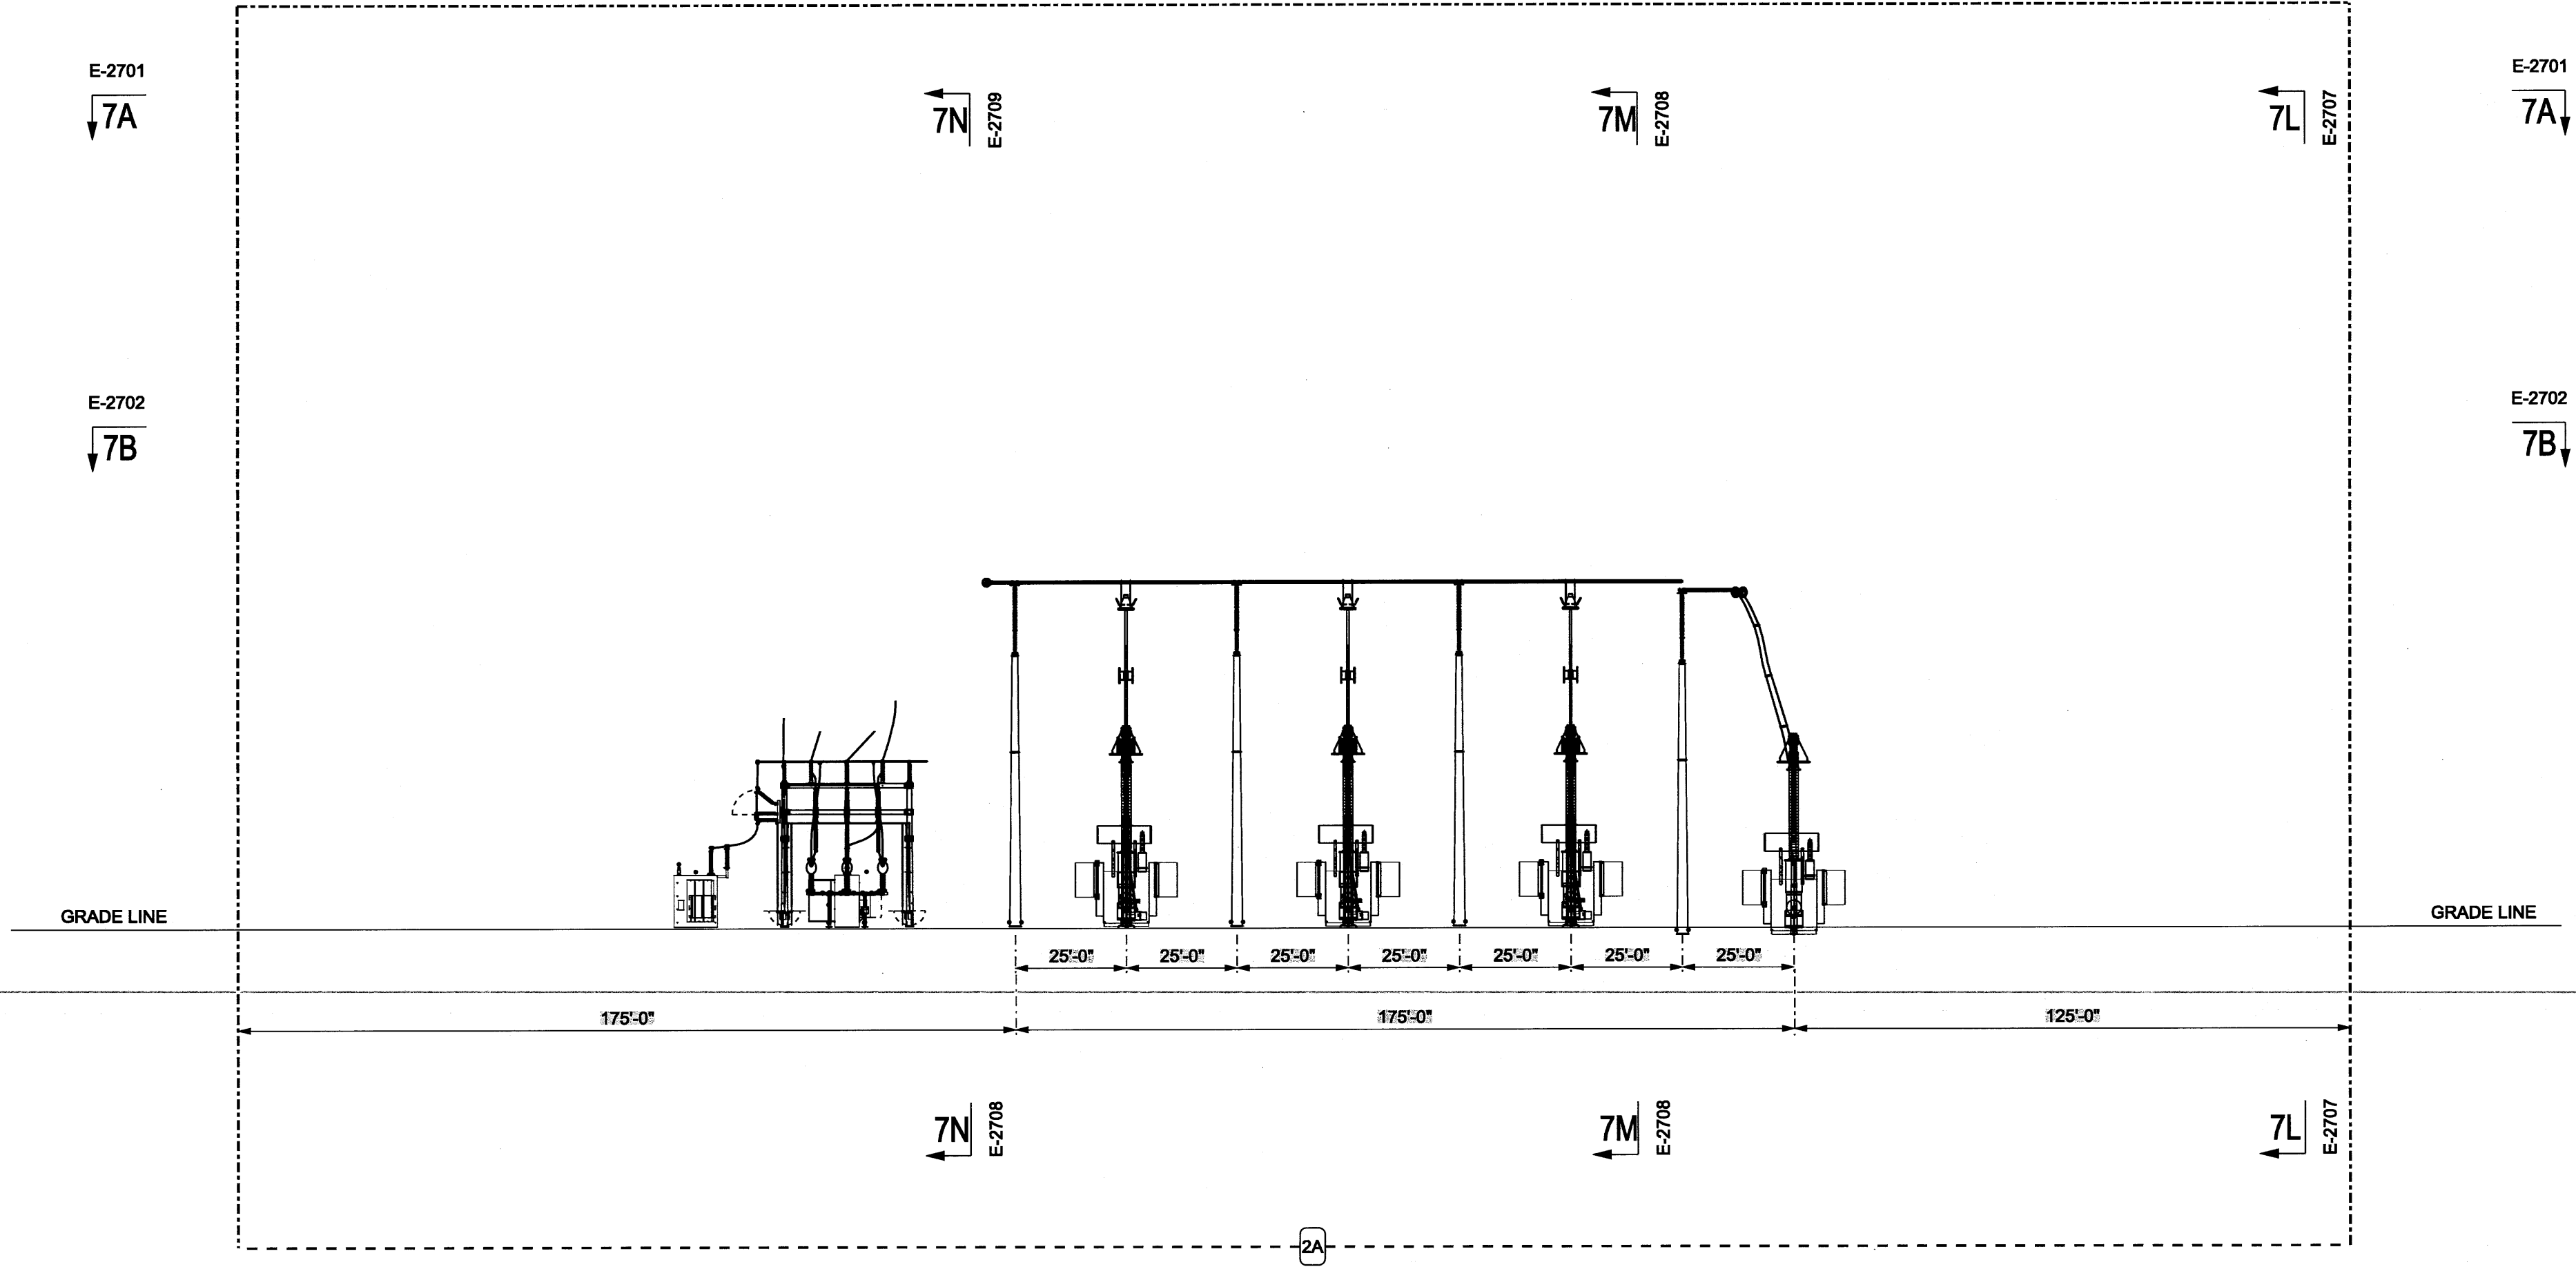


SECTION C-C

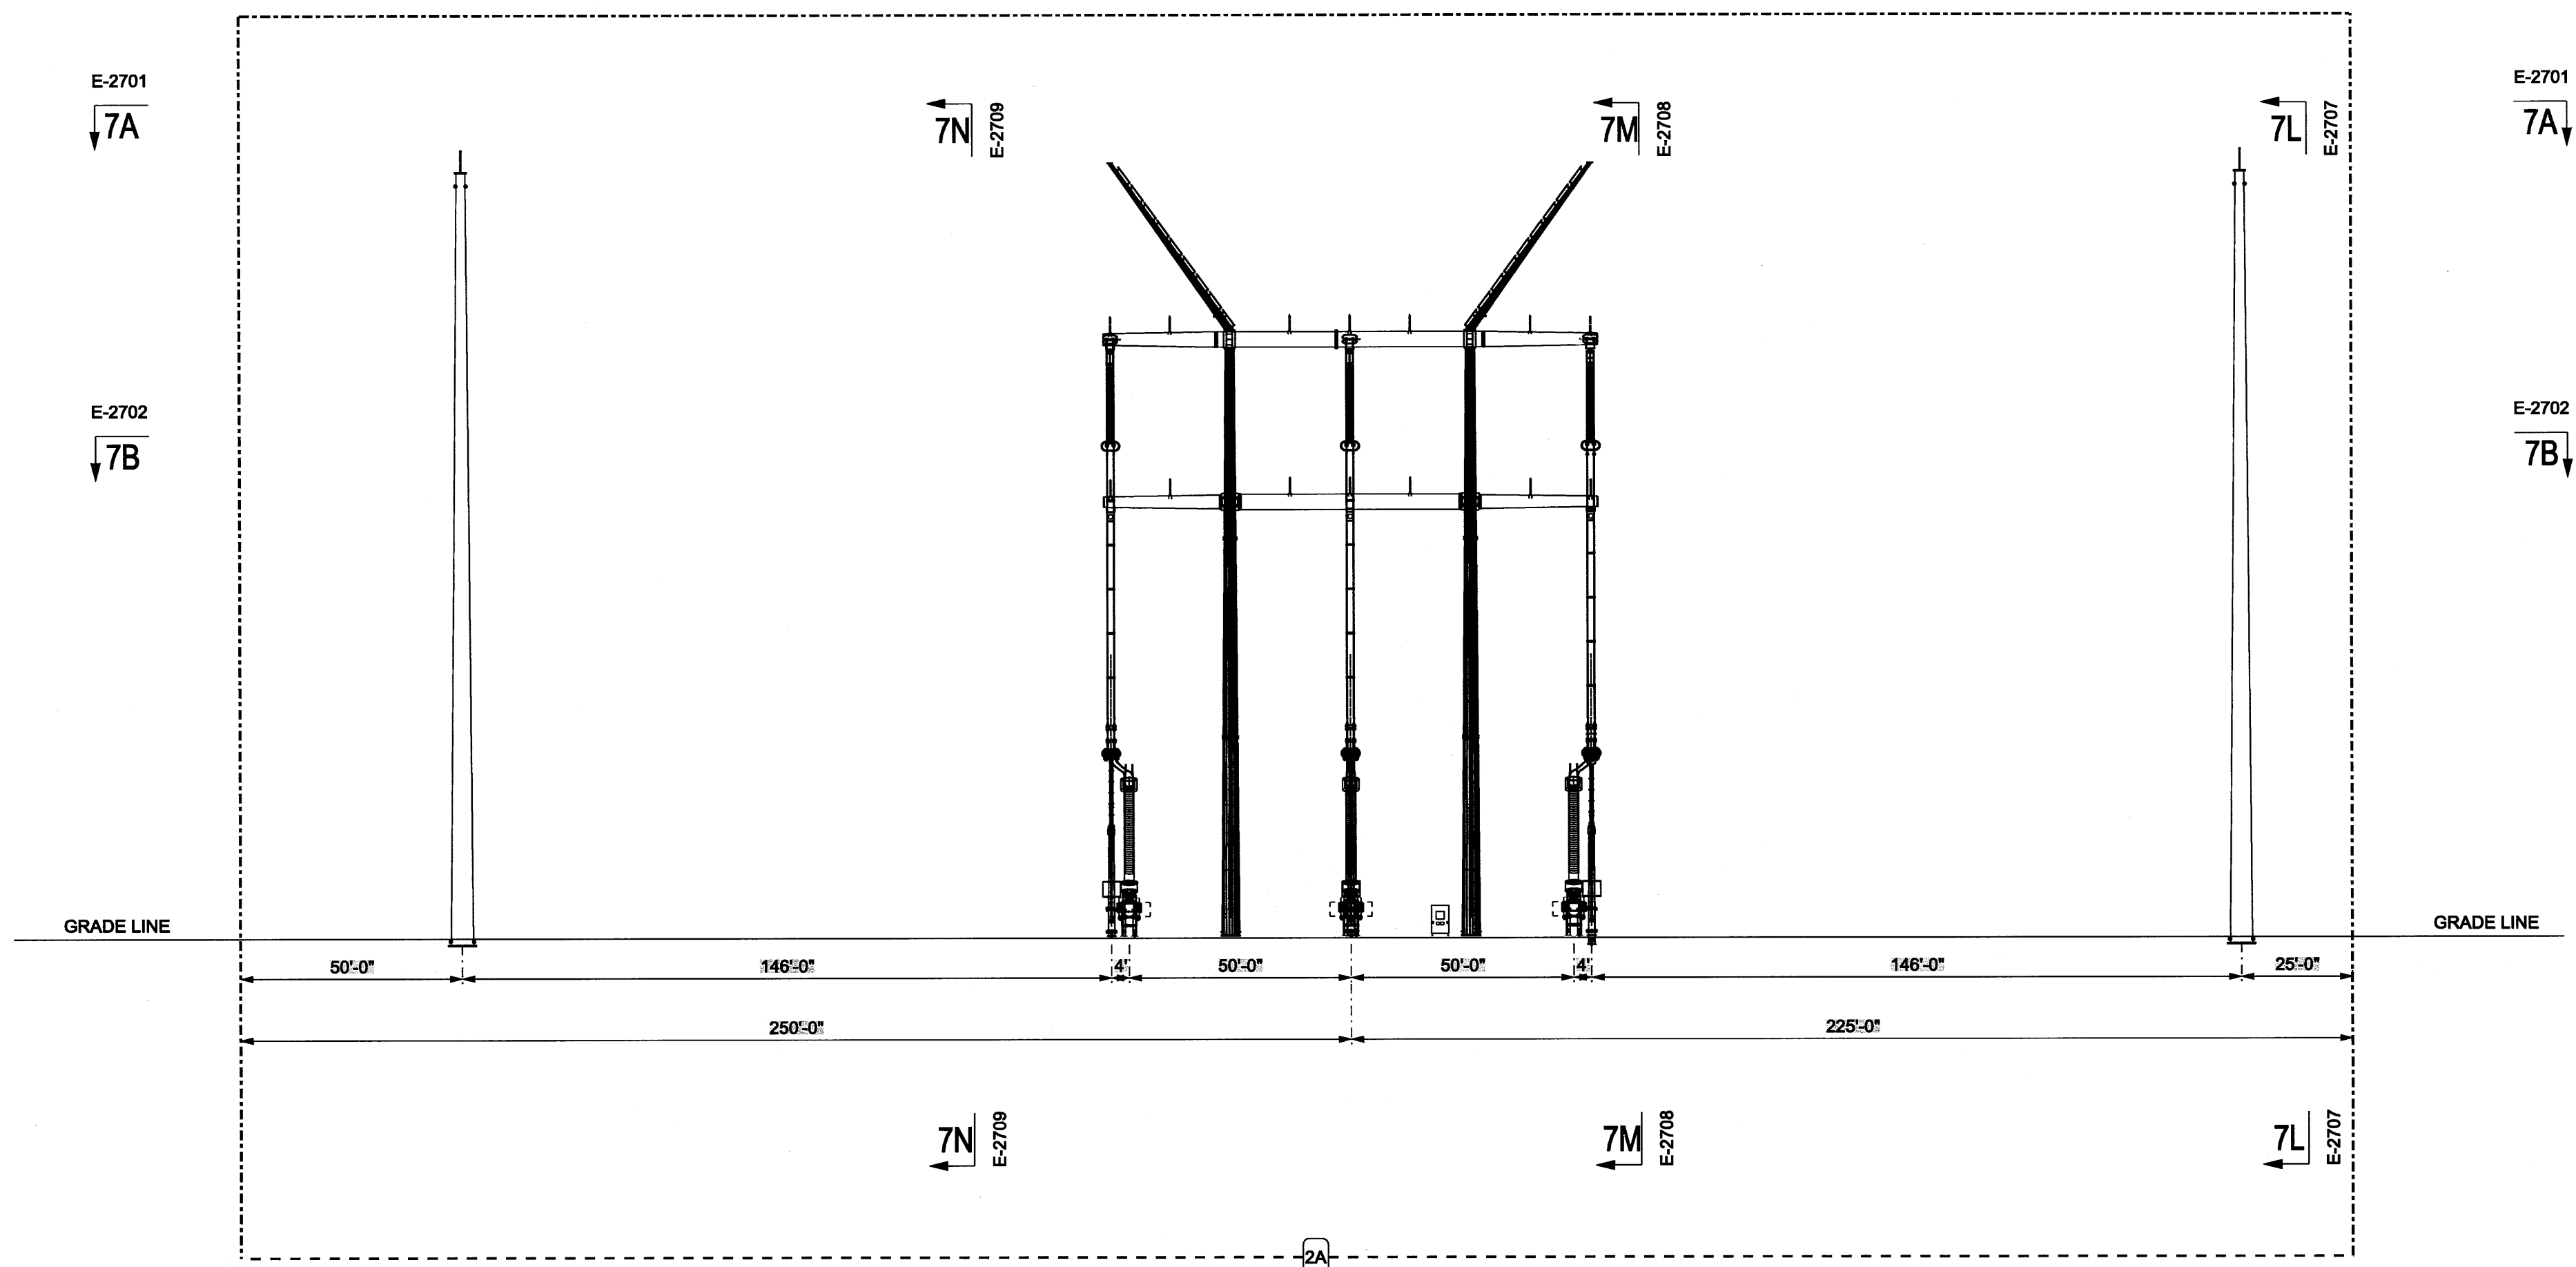

SECTION D-D

CONCEPTUAL

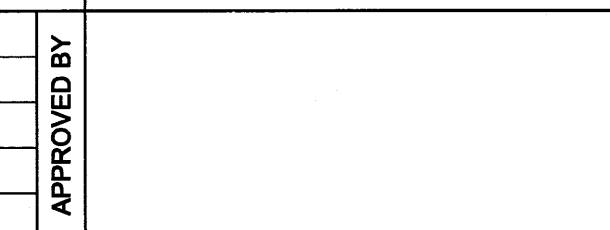ISSUE NO.	DATE	REVISION DESCRIPTION	APPROVED
OLD DWG #:		STD DWG #:	
<small>THIS DRAWING IS THE PROPERTY OF PATH TRANSMISSION COMPANY, LLC AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE PATH TRANSMISSION COMPANY, LLC. OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST.</small>			
PATH WEST VIRGINIA <b>KEMPTOWN STATION</b> MONROVIA MARYLAND 78KV <b>ELECTRICAL ASSEMBLY</b> SECTIONS "C-C", "D-D"			
DWG. NO.	E-2703		
WOR:	STATION PROJECTS ENGINEERING		
SCALE: 7C-7C	APPROVED BY		
DR: DPM			
CH:			
ENG: NONE			
DATE: 09/11/09	1 RIVERSIDE PLAZA COLUMBUS, OH 43215 R V C1		

