



CONDUCTOR SCHEDULE

3701	4326 MCM ALUM. WIRE
3703	6 INCH IPS ALUM TUBING SCH.80
3705	6 INCH IPS ALUM TUBING SCH.40

GENERAL NOTES:
 1. FOR CONSTRUCTION NOTES SEE AEP TECHNICAL SPECIFICATION FOR SUBSTATION AND SWITCHING STATION CONSTRUCTION #SS-180102

NUMBERS IN REFER TO REPORT BM#

REFERENCE DRAWINGS
 ONE LINE DIAGRAM E-

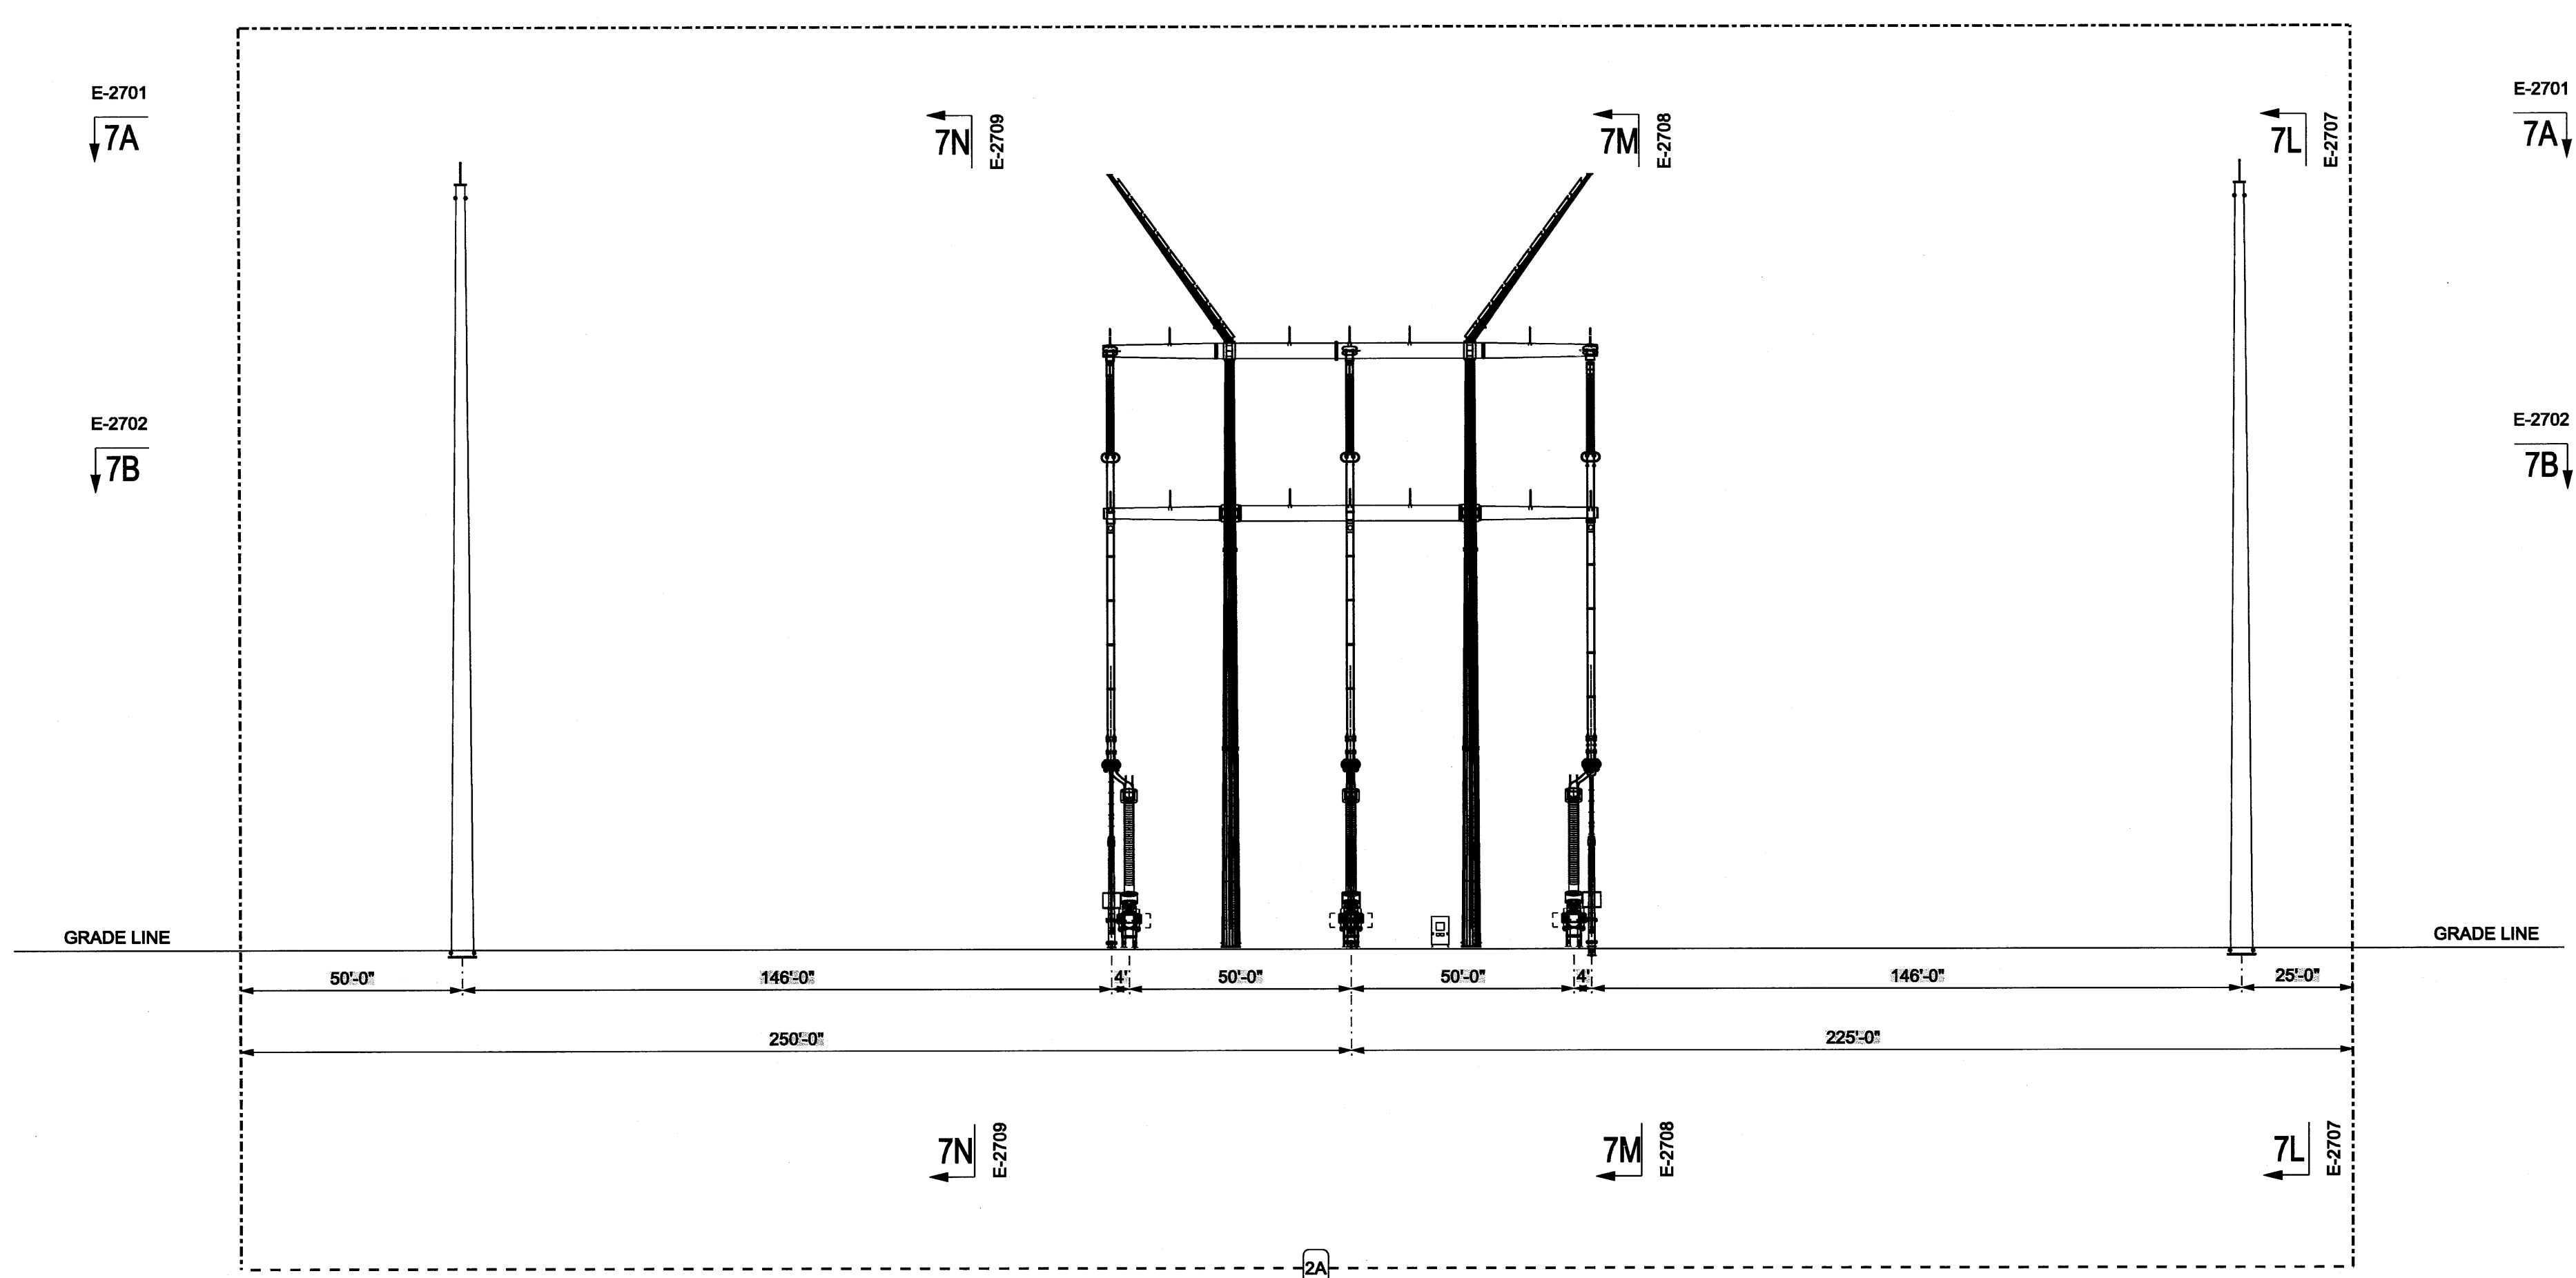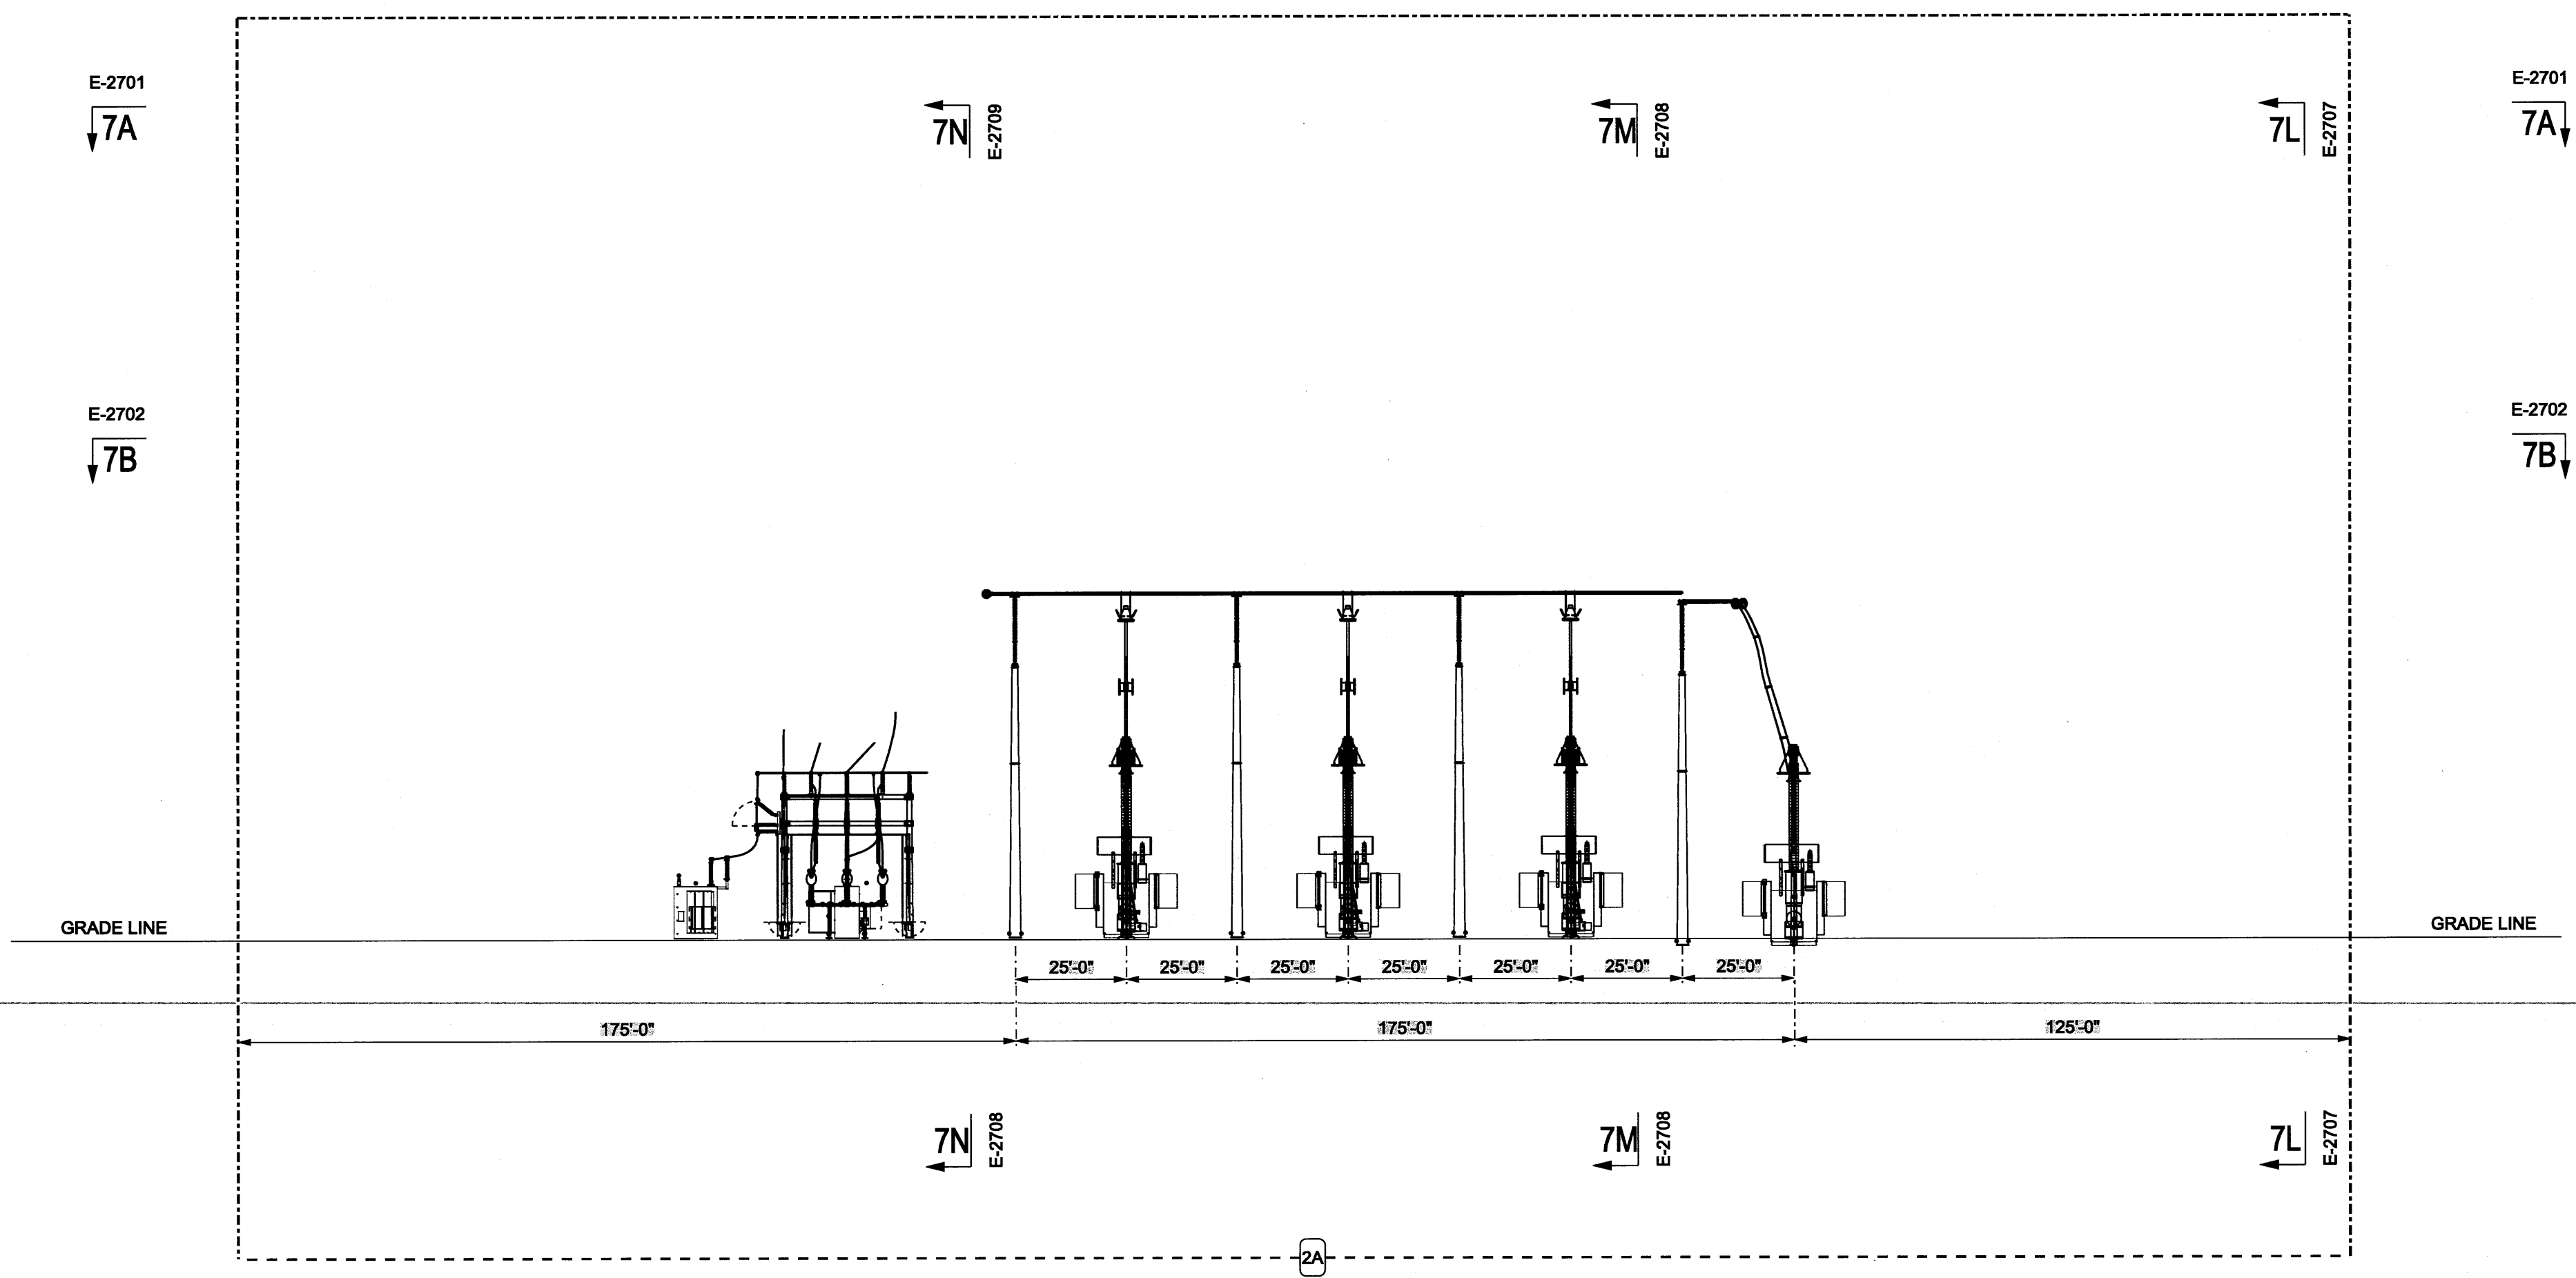

CONCEPTUAL

ISSUE	NO.	DATE	REVISION DESCRIPTION	APPR.

OLD DWG #:
 STD DWG #:

THIS DRAWING IS THE PROPERTY OF PATH TRANSMISSION COMPANY, LLC AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE PATH TRANSMISSION COMPANY, LLC. OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST.

PATH WEST VIRGINIA
KEMPTOWN STATION
 MONROVIA MARYLAND

76KV
ELECTRICAL ASSEMBLY
 SECTIONS "C-C", "D-D"

DWG. NO. **E-2703**

WOR: STATION PROJECTS ENGINEERING

SCALE: 7C-7C
 DR: DPM
 CH:
 ENG: NONE
 DATE: 09/11/09

APPROVED BY:

1 RIVERSIDE PLAZA
 COLUMBUS, OH 43215

R V C1

